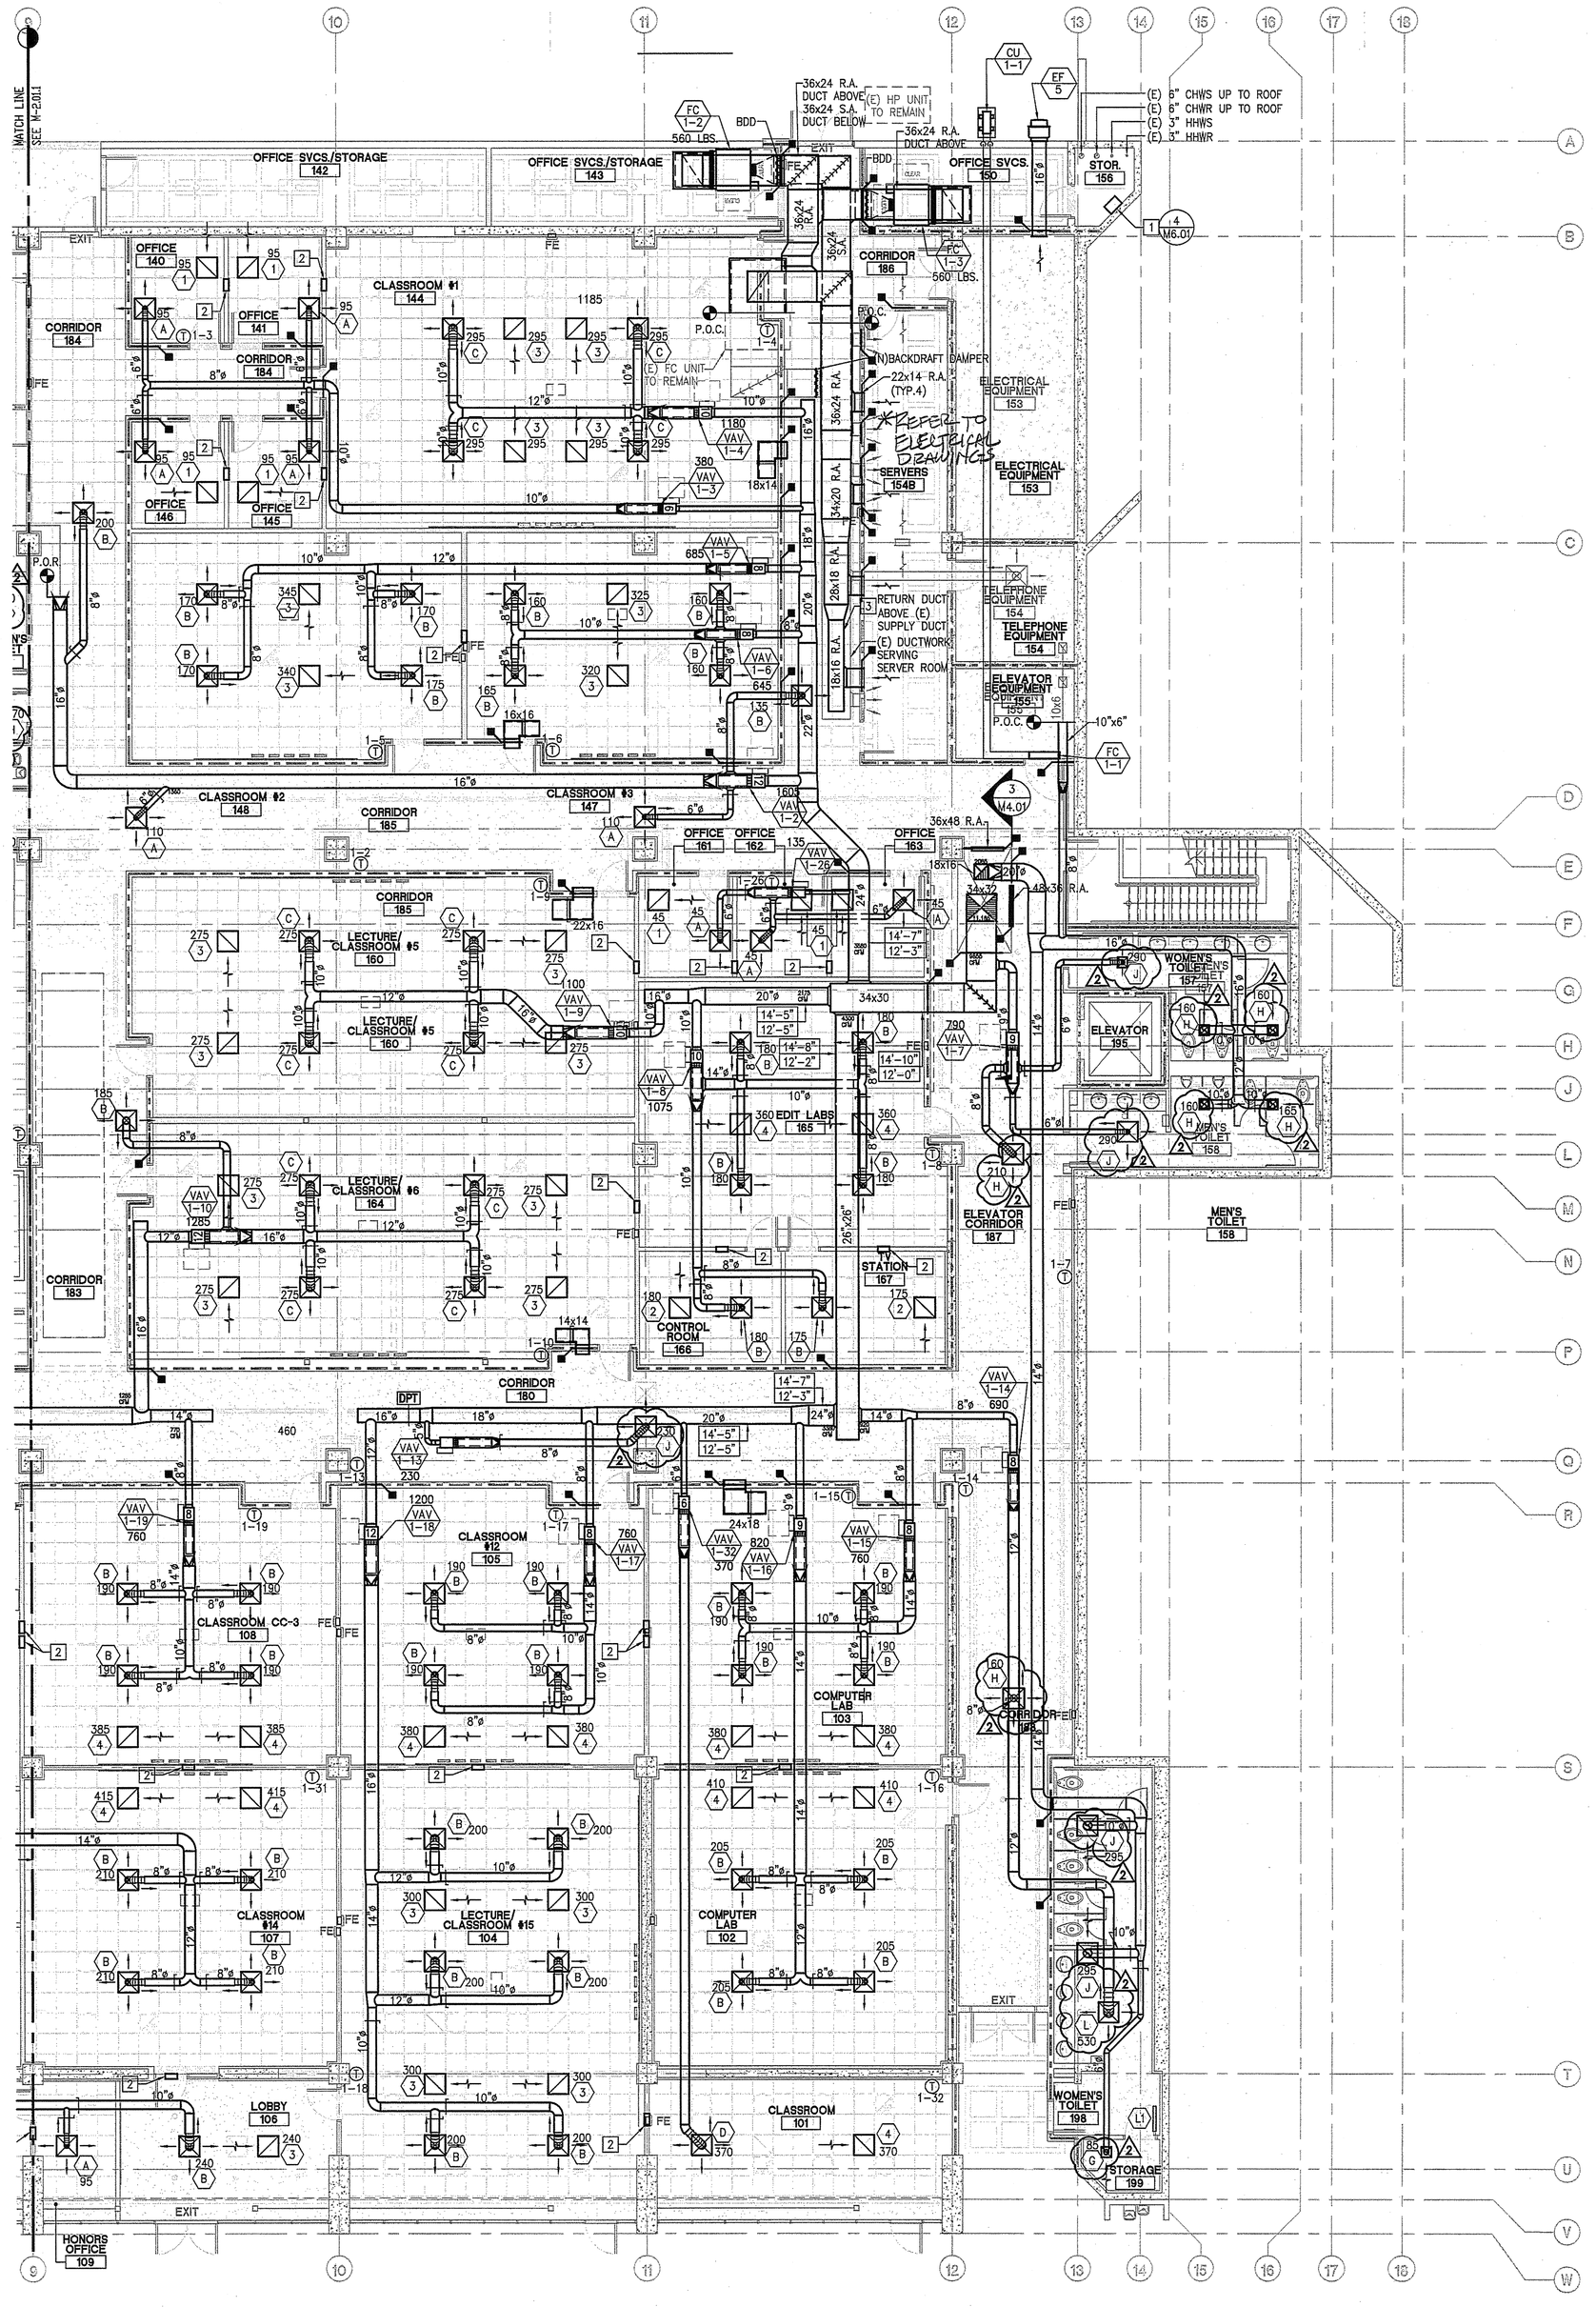

KEYNOTES THIS SHEET

1. PROVIDE AND INSTALL CONTROLATRON T4 MEASURING STATION ON CHWS, CHWR, HHWS, AND HHWR.
2. 14" X 24" RETURN AIR TRANSFER OPENING IN DRAFT STOP WALL ABOVE CEILING. LOCATE OPENING BETWEEN FRAMING STUDS.
3. ROUTE RETURN DUCT TIGHT TO UNDERSIDE OF STRUCTURE AND PENETRATE SERVER ROOM AS HIGH AS POSSIBLE ABOVE EXISTING CONDUIT. FIELD VERIFY.

LEGEND

14'-7" — TOP OF DUCT
12'-3" — BOTTOM OF DUCT

0 8' 16' 32'

KEY PLAN

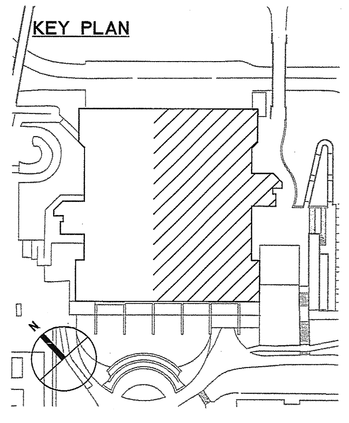

SADDLEBACK COLLEGE

gkkworks
2355 Main Street Suite 220
Irvine | CA 92614
949 250 1500
949 955 2708 fax

Architect Seal

Consultant and Seal

Fundament & Associates Inc.
Engineering Consultants
28 Executive Park, Suite 100, Irvine CA 92614 (949) 251-1131

Agency Approval

No.	Date	Revision/Issue
1	8/24/09	ADDENDUM #4
2	01/20/10	ADDENDUM #6

Project Name

JAMES B. UTT MEMORIAL LEARNING RESOURCE CENTER RENOVATION
28000 Marguerite Parkway
Mission Viejo, California 92692

Checked By | Drawn By

Sheet Title

MECHANICAL FIRST FLOOR (BASEMENT) RENOVATION PLAN (EAST)

Sheet Number

M2.012

Project Number 04-111 | Scale 1/8"=1'-0"

© 2010 gkkworks, All Rights Reserved
NO PART OF THE CONTENTS OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT THE WRITTEN PERMISSION OF GKKWORKS.

J:\7113-Saddleback Library\Mech\M2012.dwg 01/27/2010
OR331777-51697 P1 S2-R C CONSTRUCTION SERVICES - PG 155 OF 235 (P1 S2) 1 SET.TIF - 2/3/2010 - 15:34