NOT USED | SCALE NTS | 12

NOT USED | SCALE NTS | 8

NOT USED | SCALE NTS | 4

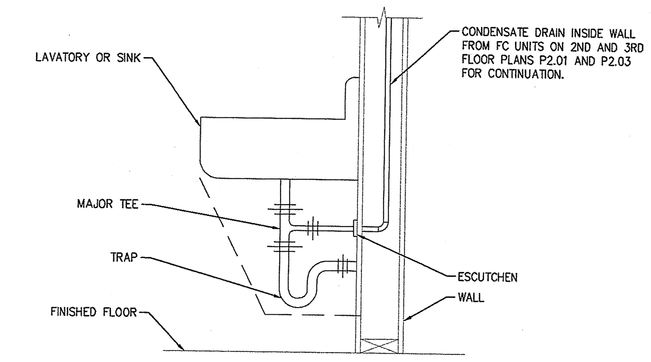

INDIRECT WASTE CONNECTION | SCALE NTS | 1

NOT USED | SCALE NTS | 13

NOT USED | SCALE NTS | 9

NOT USED | SCALE NTS | 5

NOTES:

1. PROVIDE FOUR-WAY BRACE ABOVE THE FLEXIBLE COUPLING ON THE FIRST AND SECOND FLOOR LEVEL AT THE SECOND IT IS PREFERABLY TO BE ATTACHED TO THE ROOF STRUCTURE, BUT NOT BE ATTACHED DIRECTLY TO A PLYWOOD OR METAL DECKING
2. THE FIRE SPRINKLER CONTRACTOR/INSTALLER SHALL PROVIDE ALL REQUIRED ANCHORAGE AND LATERAL BRACING DETAILS FOR THE FIRE RISER AND OVER HEAD FIRE SPRINKLER SUPPLY PIPING. SUCH DETAILS SHALL BE SHOWN ON THE DEFERRED APPROVAL SHOP DRAWINGS WITH ANCHORAGE AND CALCULATIONS FOR FIRE SPRINKLER PIPING AND COMPONENTS. ALL DETAILS SHALL BE SUPPORTED BY ENGINEERED CALCULATIONS, PERFORMED BY A STRUCTURAL ENGINEER LICENSED IN THE STATE OF CALIFORNIA. FIRE SPRINKLER CONTRACTOR SHALL COORDINATE WITH STRUCTURAL ENGINEER PRIOR TO COMMENCEMENT OF OF FIRE SPRINKLER SYSTEM INSTALLATION.
3. REFER TO M0.01 AND P0.01 FOR FIRE SPRINKLER NOTES, AND ADDITIONAL INFORMATION.
4. REFER TO S1.1 FOR ANCHORAGE REQUIREMENTS.

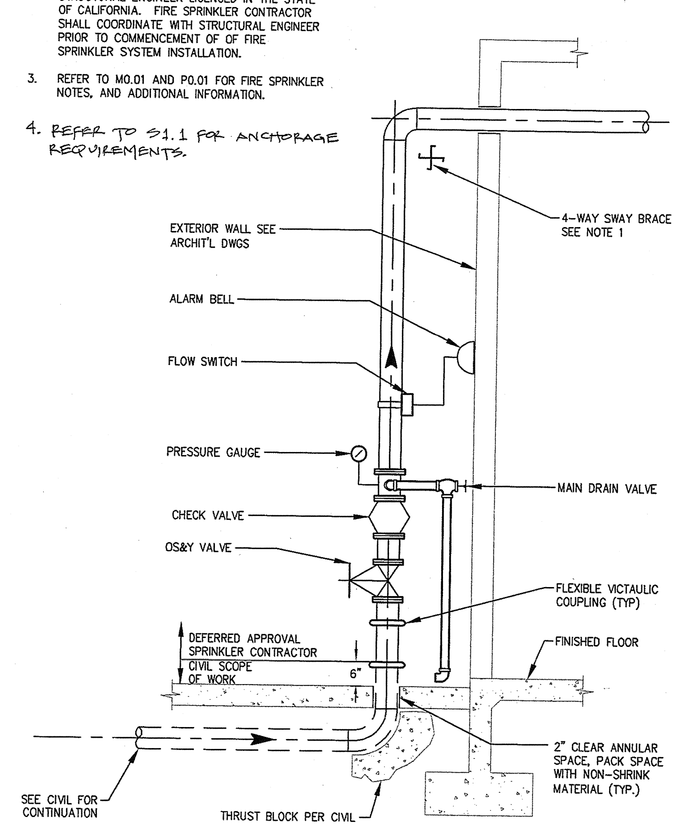

AUTOMATIC SPRINKLER RISER (DEFERRED ITEM) | SCALE NTS | 2

NOT USED | SCALE NTS | 14

NOT USED | SCALE NTS | 10

NOT USED | SCALE NTS | 6

NOTES:

1. CONTRACTOR SHALL SECURE ALL ITEMS SHOWN TO STRUCTURE PER MANUFACTURERS RECOMMENDATIONS. PROVIDE ALL NECESSARY COMPONENTS AND HARDWARE.

SV 1 — SEISMIC GAS SHUT-OFF VALVE: 2" KOSO, 60 PSI MAX. W.P..

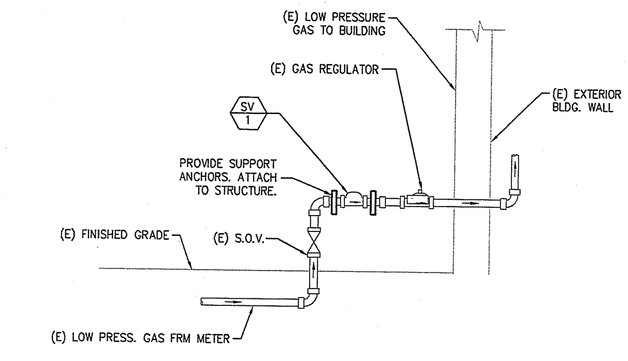

(E) REGULATED NATURAL GAS INTO BUILDING | SCALE NTS | 3

NOT USED | SCALE NTS | 15

NOT USED | SCALE NTS | 11

NOT USED | SCALE NTS | 7

SADDLEBACK COLLEGE

gkkworks
2355 Main Street Suite 220
Irvine | CA 92614
949 250 1500
949 955 2708 fax

Architect Seal

Consultant and Seal

REGISTERED PROFESSIONAL ENGINEER — MECHANICAL — No. 24371 — STATE OF CALIFORNIA

Fundament & Associates Inc. Engineering Consultants
20 Executive Park, Suite 100, Irvine CA 92614 (949) 251-1131

Agency Approval

CERTIFICATION STAMP DIV. OF THE STATE ARCHITECT OFFICE OF SCHOOL CONSTRUCTION SERVICES
04 109129
DATE MAY 07 2008

No.	Date	Revision/Issue

Project Name

JAMES B. UTT MEMORIAL LEARNING RESOURCE CENTER RENOVATION
28000 Marguerite Parkway
Mission Viejo, California 92692

Checked By	Drawn By
EM	CT

Sheet Title

PLUMBING DETAILS SHEET

Sheet Number

P5.01

Project Number	Scale
04-111	NTS

© 2008 gkkworks, All Rights Reserved
NO PART OF THE CONTENTS OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT THE WRITTEN PERMISSION OF GKKWORKS.

J:\7113-Saddleback Library\Plumb\7113-P5.01.dwg 05/01/2008
A831777-51697 P1 S2 - R C CONSTRUCTION SERVICES - PG 194 OF 235 (P1 S2) 1 SET.TIF - 2/3/2010 - 15:34