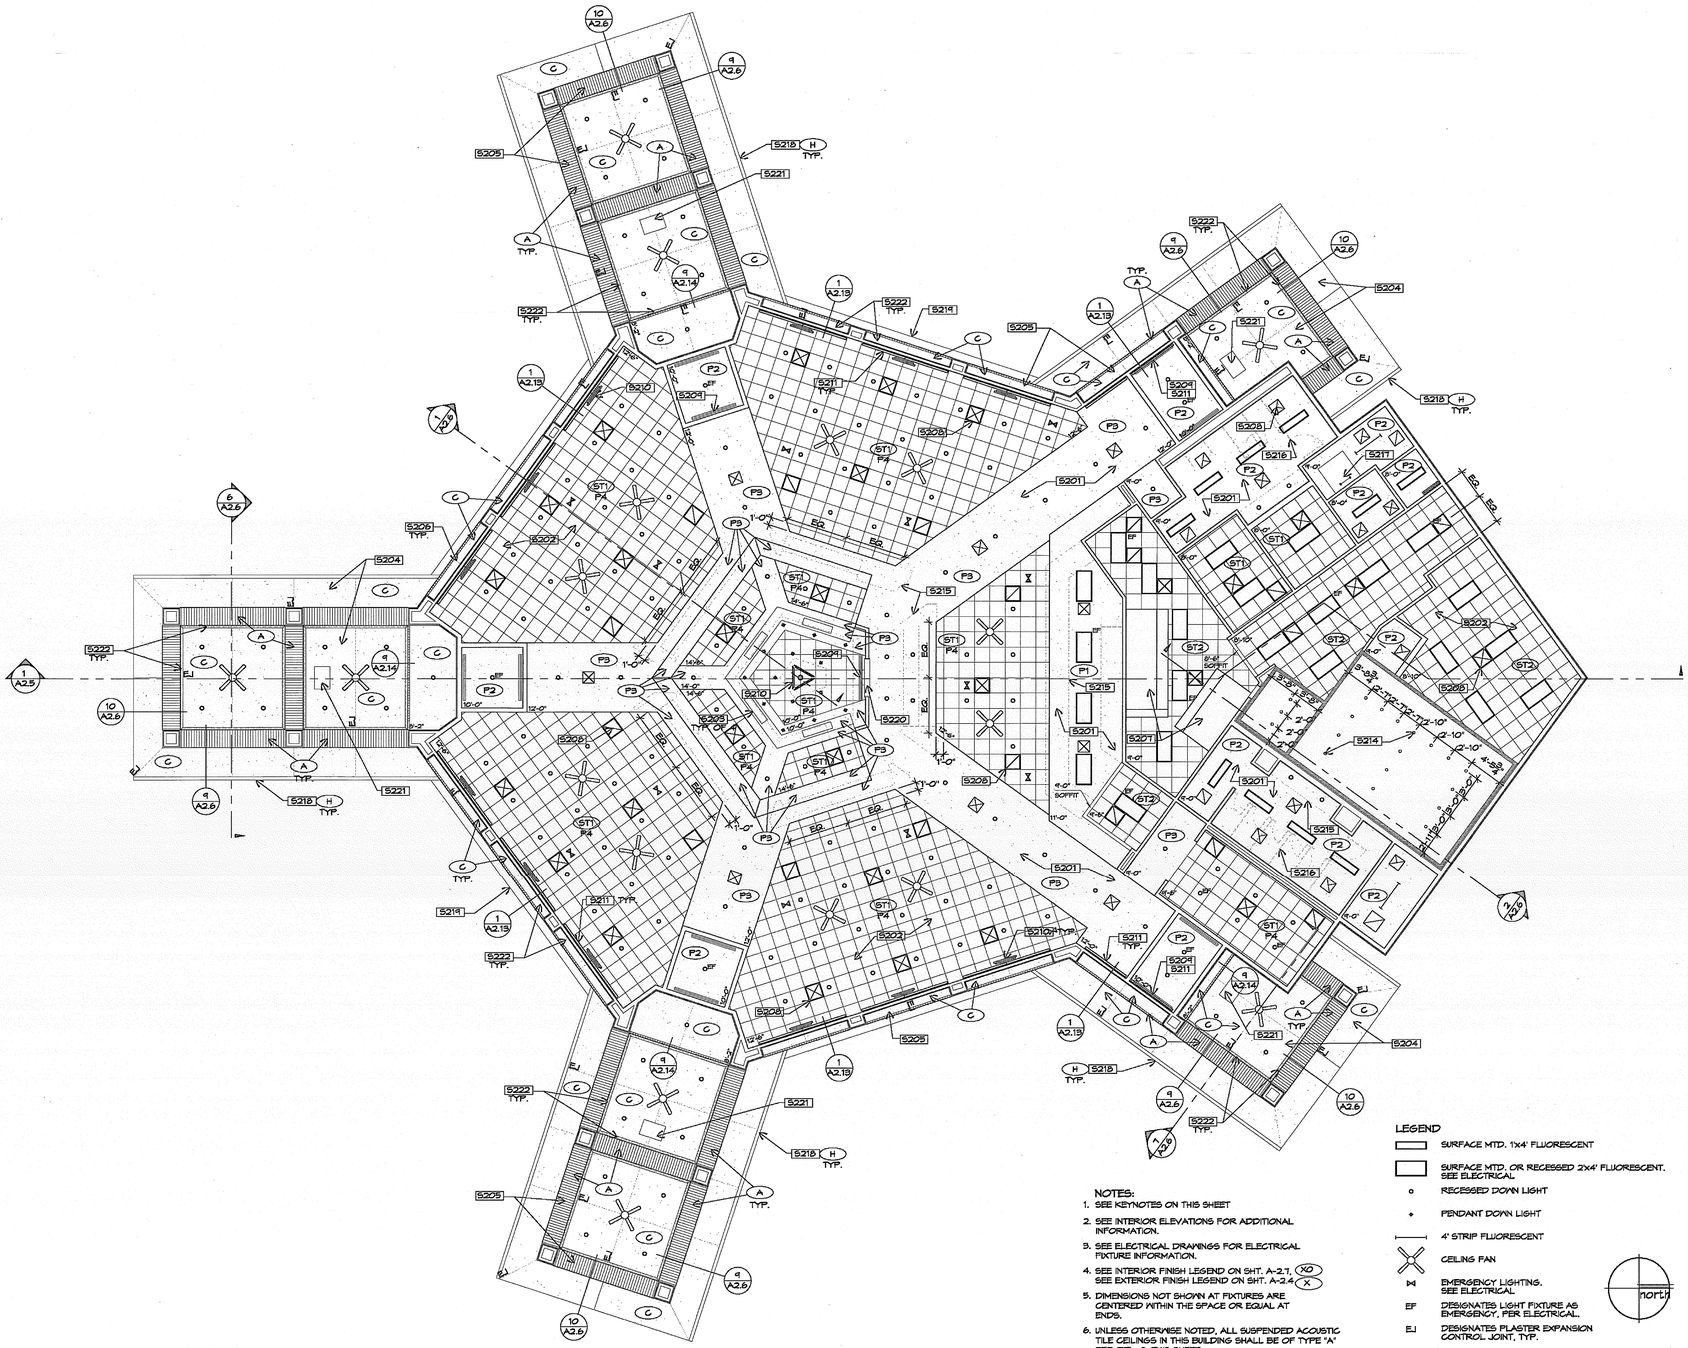

NOTES:
1. SEE KEYNOTES ON THIS SHEET
2. SEE INTERIOR ELEVATIONS FOR ADDITIONAL INFORMATION.
3. SEE ELECTRICAL DRAWINGS FOR ELECTRICAL FIXTURE INFORMATION.
4. SEE INTERIOR FINISH LEGEND ON SHT. A-2.1, XO SEE EXTERIOR FINISH LEGEND ON SHT. A-2.4 X
5. DIMENSIONS NOT SHOWN AT FIXTURES ARE CENTERED WITHIN THE SPACE OR EQUAL AT ENDS.
6. UNLESS OTHERWISE NOTED, ALL SUSPENDED ACOUSTIC TILE CEILINGS IN THIS BUILDING SHALL BE OF TYPE "A" PER DTL. 2, THIS SHEET.

LEGEND

▭	SURFACE MTD. 1x4' FLUORESCENT
▭	SURFACE MTD. OR RECESSED 2x4' FLUORESCENT. SEE ELECTRICAL
○	RECESSED DOWN LIGHT
◆	PENDANT DOWN LIGHT
├─┤	4' STRIP FLUORESCENT
✕	CEILING FAN
⋈	EMERGENCY LIGHTING. SEE ELECTRICAL
EF	DESIGNATES LIGHT FIXTURE AS EMERGENCY, PER ELECTRICAL.
EJ	DESIGNATES PLASTER EXPANSION CONTROL JOINT, TYP.

north

Stadium Club - Reflected Ceiling Plan

SCALE: 1/8"=1'-0" | 1

5201	GYP. BOARD CEILING PER SECTIONS & DETAILS. NOTED CLG. HEIGHT IS TO UNDERSIDE OF FRAMING OR SUSPENSION.
5202	SUSPENDED ACOUSTIC TILE CEILING W/ 2x2 T-BAR GRID. BRACING PER "S.A.T. BRACING" DETAIL, 2/A2.2.
5203	OPENING IN ANGLED CEILING SOFFIT PER SECTIONS & DTLS.
5204	EXTERIOR PLASTER AT UNDERSIDE OF ROOF OVERHANG OR SOFFIT.
5205	UNDERSIDE OF SOFFIT PER SECTIONS & DTLS.
5206	NOT USED.
5207	KITCHEN EXHAUST HOOD PER KITCHENS & MECHANICAL.
5208	HVAC RESISTER. TYPE & SIZE PER MECHANICAL. LOCATE AS SHOWN ON THIS PLAN.
5209	LINEAR HVAC DIFFUSER. TYPE & SIZE PER MECHANICAL. LOCATE AS SHOWN ON THIS PLAN.
5210	TELEVISION AND MOUNTING BRACKET BY OWNER. LOCATE PER INTERIORS. SEE ELECTRICAL FOR POWER AND DATA.
5211	SUNSHADE. SEE SPECIFICATIONS.
5212	NOT USED.
5213	NOT USED.
5214	LIGHTING FOR COOLER & FREEZER PER COOLER/ FREEZER MFGR.
5215	LINE OF CABINETRY AND/ OR COUNTERTOP BELOW.
5216	LINE OF TOILET PARTITION BELOW.
5217	LADDER & ROOF HATCH. SEE SPECIFICATIONS.
5218	UNDERSIDE OF ROOF GUTTER. SEE ROOF PLAN & EXTERIOR ELEVATIONS FOR DOWNSPOUT LOCATIONS.
5219	"ANNOUNCER BOOTH" FEATURE. SEE ROOF PLANS, EXTERIOR ELEVATIONS AND DETAILS.
5220	OPENING IN WALL BELOW. SEE INTERIORS AND DETAILS.
5221	25"X35" 14 GA. CEILING ACCESS PANEL IN 16 GA. FRAME W/ CONTINUOUS PIANO HINGE AND CYLINDER LOCK W/ DUST SHUTTER. FACTORY PRIME AND FIELD PAINT TO MATCH ADJACENT SURFACE. MAINTAIN MIN. 30" CLEAR HT. ABOVE PANEL.
5222	FRY PCS-TB-V-400 SOFFIT VENT. CONTINUOUS WHERE SHOWN.

Clg. Plan Key Notes

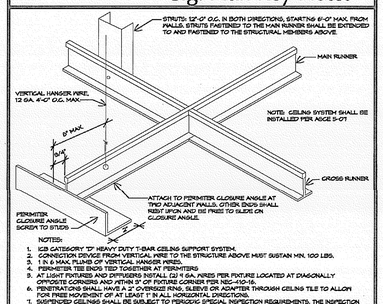

NOTES:
1. ICBO CATEGORY "D" HEAVY DUTY T-BAR CEILING SUPPORT SYSTEM.
2. CONNECTION DEVICE FROM VERTICAL WIRE TO THE STRUCTURE ABOVE MUST SUSTAIN MIN. 100 LBS.
3. 1 IN 6 MAX. PLUMB OF VERTICAL HANGER WIRES.
4. PERIMETER TEE ENDS TIED TOGETHER AT PERIMETERS
5. AT LIGHT FIXTURES AND DIFFUSERS INSTALL (2) 12 GA. WIRES PER FIXTURE LOCATED AT DIAGONALLY OPPOSITE CORNERS AND WITHIN 3" OF FIXTURE CORNER PER NEC-410-16.
6. PENETRATIONS SHALL HAVE A 2" OVERSIZED RING, SLEEVE OR ADAPTER THROUGH CEILING TILE TO ALLOW FOR FREE MOVEMENT OF AT LEAST 1" IN ALL HORIZONTAL DIRECTIONS.
7. SUSPENDED CEILINGS SHALL BE SUBJECT TO PERIODIC SPECIAL INSPECTION REQUIREMENTS. THE INSPECTION ENTAILS MANUFACTURER CERTIFICATION OF COMPONENT PERFORMANCE AND PERIODIC INSPECTION OF THE SUSPENDED CEILING SYSTEM ANCHORAGE SYSTEM.

A - USE AT CEILING AREAS LESS THAN OR EQUAL TO 1,000 S.F.

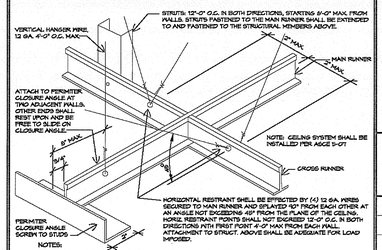

NOTES:
1. ICBO CATEGORY "D" HEAVY DUTY T-BAR CEILING SUPPORT SYSTEM.
2. CONNECTION DEVICE FROM VERTICAL WIRE TO THE STRUCTURE ABOVE MUST SUSTAIN MIN. 100 LBS.
3. 1 IN 6 MAX. PLUMB OF VERTICAL HANGER WIRES.
4. PERIMETER TEE ENDS TIED TOGETHER AT PERIMETERS
5. AT LIGHT FIXTURES AND DIFFUSERS INSTALL (2) 12 GA. WIRES PER FIXTURE LOCATED AT DIAGONALLY OPPOSITE CORNERS AND WITHIN 3" OF FIXTURE CORNER PER NEC-410-16.
6. PENETRATIONS SHALL HAVE A 2" OVERSIZED RING, SLEEVE OR ADAPTER THROUGH CEILING TILE TO ALLOW FOR FREE MOVEMENT OF AT LEAST 1" IN ALL HORIZONTAL DIRECTIONS.
7. SUSPENDED CEILINGS SHALL BE SUBJECT TO PERIODIC SPECIAL INSPECTION REQUIREMENTS. THE INSPECTION ENTAILS MANUFACTURER CERTIFICATION OF COMPONENT PERFORMANCE AND PERIODIC INSPECTION OF THE SUSPENDED CEILING SYSTEM ANCHORAGE SYSTEM.

B - USE AT CEILING AREAS GREATER THAN 1,000 S.F. OR WHERE ADD'L. BRACING IS REQUIRED.

S.A.T. Bracing

SCALE: NTS | 2

5101	ALUMINUM ENTRANCE DOORS AND SIDELITE WHERE OCCURS. SEE ELEVATIONS, SECTIONS, AND DETAILS.
5102	ALUMINUM WINDOW WALL. SEE ELEVATIONS, SECTIONS AND DETAILS.
5103	ALUMINUM WINDOW. SEE ELEVATIONS, SECTIONS AND DETAILS.
5104	FRAMED OPENING. SEE INTERIORS, SECTIONS, & DETAILS.
5105	PASS-THRU OPENING W/ SHELF. SEE KITCHENS.
5106	FREEZER/ COOLER DOOR PER MFGR.
5107	QUICK-ACCESS FREEZER DOOR PER MFGR.
5108	TRASH CAN BY OWNER.
5109	AMSEC "BWB3020" DEPOSIT SAFE WITH DROP SLOT PER MFGR'S. INSTRUCTIONS. OWNER FURNISHED, CONTRACTOR INSTALLED.
5110	FIRE SPRINKLER RISER LOCATION.
5111	ROOF ACCESS LADDER TO ROOF HATCH.
5112	SERVER RACK PER ELECTRICAL AND SPECS.
5113	JANITOR'S SERVICE SINK. SEE PLUMBING AND SPECS.
5114	WALL MOUNTED HAND SINK. SEE PLUMBING AND SPECS.
5115	COUNTERTOP MOUNTED HAND SINK. SEE PLUMBING AND SPECS.
5116	TOILET. SEE PLUMBING AND SPECIFICATIONS.
5116A	ACCESSIBLE TOILET. SEE PLUMBING AND SPECIFICATIONS. SEE SHT. GN-1 FOR ACCESSIBILITY REQ'S.
5117	URINAL. SEE PLUMBING AND SPECIFICATIONS.
5117A	ACCESSIBLE URINAL. SEE PLUMBING AND SPECIFICATIONS. SEE SHT. GN-1 FOR ACCESSIBILITY REQ'S.
5118	WATER HEATER. SEE PLUMBING AND SPECIFICATIONS.
5119	TOILET PARTITIONS. SEE INTERIORS AND SPECIFICATIONS.
5120	DOUBLE-STACKED LOCKERS. SEE INTERIORS AND SPECS.
5121	SOLID SURFACE COUNTERTOP W/ SINKS PER PLUMBING.
5122	CUSTOMER COUNTER. SEE INTERIORS.
5123	DISPLAY COUNTER WITH 1/4" TEMPERED GLASS FACE AND TOP. SEE INTERIORS AND DETAILS.
5124	SPLIT LEVEL CONDIMENT COUNTER. SEE INTERIORS AND DETAILS.
5125	BAR W/ INTEGRAL SERVING RAIL. SEE INTERIORS AND DETAILS.
5126	ACCESSIBLE BAR COUNTER. SEE INTERIORS.
5127	BAR ACCESS PANEL W/ HALF-DOOR AND HINGED LIFT-UP PANEL.
5128	BAR W/ PARTIAL HEIGHT WALL SURROUNDING. SEE INTERIORS.
5129	LOCKABLE UPPER CABINET FOR LIQUOR. SEE INTERIORS.
5130	INTERNAL BAR ISLAND W/ BEER TAPS. SEE INTERIORS & KITCHENS.
5131	KITCHEN SERVICE EQUIPMENT. SEE KITCHENS AND SPECS.
5132	POINT OF SALE. SEE ELECTRICAL FOR CONNECTION TO POWER AND BUILDING DATA NETWORK.
5133	MODULAR SHELVING. SEE KITCHENS AND SPECS.
5134	COOLER/ FREEZER WALL. SEE KITCHENS, SPECIFICATIONS, MECHANICAL, PLUMBING & ELECTRICAL.
5135	CONCEALED COLUMN PER STRUCTURAL.
5136	EXPOSED PIPE COLUMN PER STRUCTURAL.
5137	LINE OF SILL/ LEDGE BELOW. SEE DETAILS.
5138	DEPRESSED WALKWAY AND STAIRS PER CIVIL. SEE SITE PLAN AND CIVIL DRAWINGS FOR ACTUAL DESIGN.
5139	LINE OF ROOF OVERHANG, ARCH, OR SOFFIT ABOVE. SEE REFLECTED CEILING PLANS FOR ADD'L. INFORMATION.
5140	ACCESSIBILITY PLACARD. SEE GN-1 "ENTRANCE SIGNAGE"
5141	CORNER GUARD PER SPECS. HEIGHT AS SHOWN ON INTERIORS.
5142	FIRE EXTINGUISHER. SEE GENERAL NOTES, THIS SHEET.
5143	COIN MACHINE BY OTHERS.
5144	ATM BY OTHERS.
5145	8"x24" WOOD SHELF @ +42" A.F.F. FOR EMPLOYEE TIME CLOCK.
5146	NOT USED.

Plan Key Notes

MIG
MOORE IACOFANO GOLTSMAN, INC.
601 N. HAZEL ST. BLVD.
FULLERTON, CA 92831
TEL 714/871-3638
FAX 714/871-1183
www.mig.com

PITASSI ARCHITECTS, INC.
8439 White Oak Ave., Suite. 105
Rancho Cucamonga, Ca 91730
Tel. 909-980-1361 ▪ Fax. 909-944-5814
e-mail. pjpaia@pitassiarchitects.com

CONSULTANT:

PERRIS VALLEY Big League Dreams

2155 Trumble Road
Perris, California 92570

SHEET TITLE

100% CONSTRUCTION DOCUMENT

DATE	REVISIONS

STAMP

REGISTERED PROFESSIONAL ENGINEER C 61446 STATE OF CALIFORNIA

CHECKED BY	DATE
-	-
DATE 01-07-10	FILE NAME
DRAWN BY -	SHEET A-2.2
JOB NO. 05208.00	
SCALE	OF SHEETS