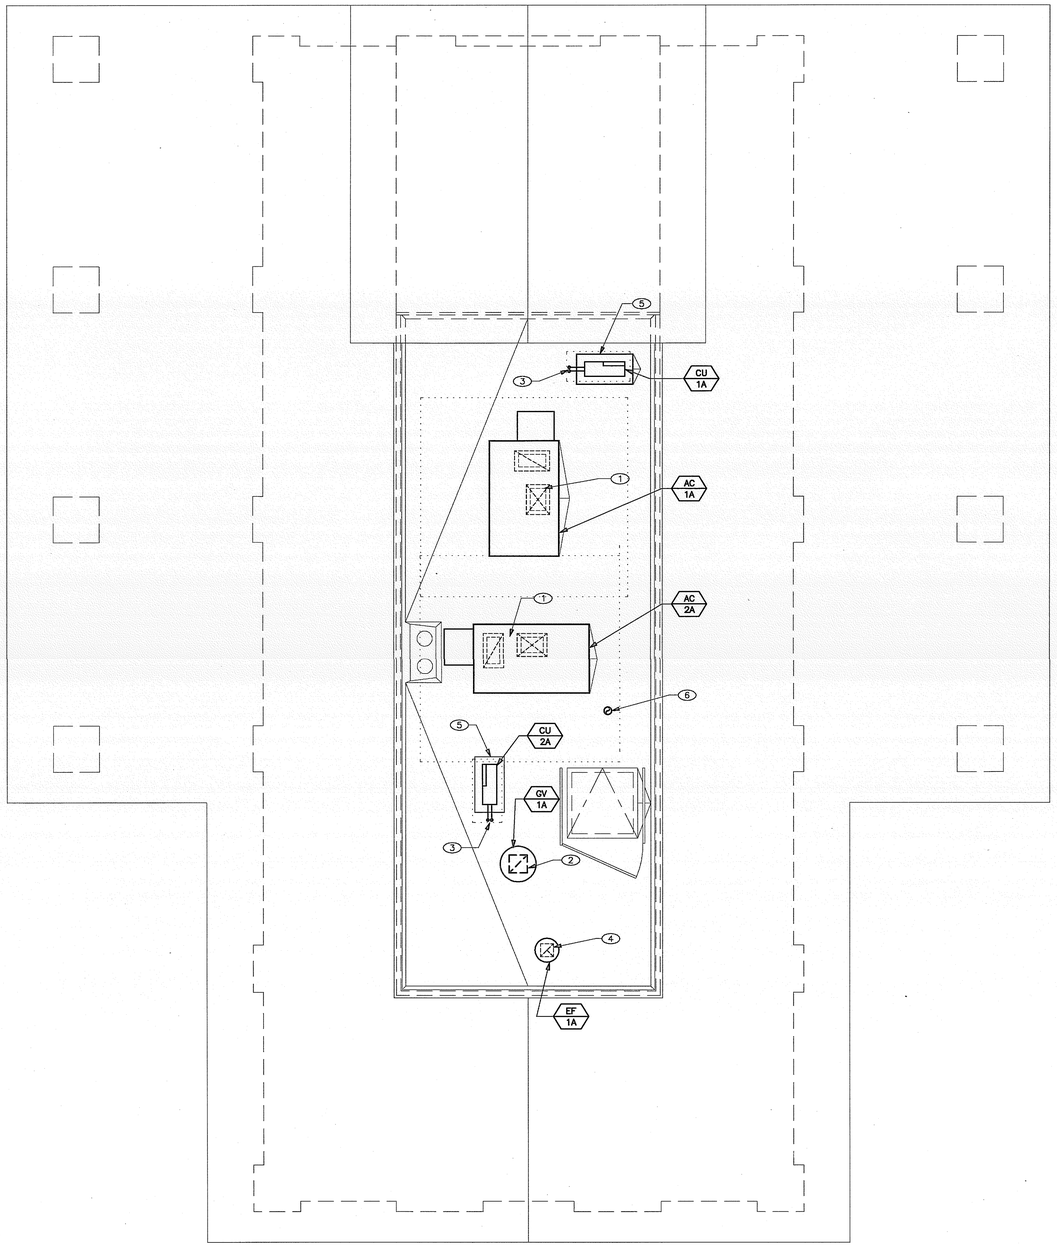

PROJECT NORTH

SHEET NOTES

1. 23"x18" LINED SUPPLY AND 15"x27" LINED RETURN AIR DUCTS DOWN THRU' ROOF.
2. 14"x14" MAKE-UP AIR DUCT DOWN THRU' ROOF.
3. 3/8"(RL) & 3/4"(RL) REFRIGERANT PIPING DOWN THRU' ROOF.
4. 10"x10" EXHAUST AIR DUCT DOWN THRU' ROOF.
5. 6" MIN. HIGH EQUIPMENT PLATFORM BY G.C.
6. 6"ø EXHAUST AIR DUCT WITH ROOF CAP.

GENERAL NOTES

A. CONTRACTOR SHALL CONFIRM FINAL REFRIGERANT PIPE SIZING UPON DETERMINATION OF ACTUAL DEVELOPED LENGTH.

B. FRESH AIR INTAKES SHALL BE 10'-0" MIN. AWAY FROM ALL EXHAUST OUTLETS, PLUMBING VENTS, AND FLUES.

C. CONTRACTOR SHALL COORDINATE EXACT EQUIPMENT PAD SIZES AND LOCATIONS WITH OTHER TRADES, INCLUDING GENERAL CONTRACTOR PRIOR TO INSTALLATION.

D. MAINTAIN MANUFACTURER MIN. CLEARANCES ON ALL ROOF-TOP MECHANICAL EQUIPMENT.

MIG

MOORE IACOFANO GOLTSMAN, INC.
801 N. HARBOR BLVD.
FULLERTON, CA 92831
TEL 714/871-3638
FAX 714/871-1188
www.migcom.com

PITASSI ARCHITECTS, INC.
8439 White Oak Ave., Suite. 105
Rancho Cucamonga, Ca 91730
Tel. 909-980-1361 ■ Fax. 909-944-5814
e-mail. pjpaia@pitassiarchitects.com

CONSULTANT:

GLUMAC
16735 Von Karman Ave., Suite 250
Irvine, CA 92606-4665
T. 949.833.8160 F. 949.833.0252
www.glumac.com
Job No.: 408134PI
Contact: RG/AK
engineers for a sustainable future™

PERRIS VALLEY Big League Dreams

2155 Trumble Road
Perris, California 92570

SHEET TITLE
ADMINISTRATION BUILDING MECHANICAL ROOF PLAN

100% CONSTRUCTION DOCUMENT

DATE	REVISIONS

STAMP

REGISTERED PROFESSIONAL ENGINEER
RICHARD HOLZER
No. 22041
01-05-10
MECHANICAL
STATE OF CALIFORNIA

CHECKED BY	DATE
-	-

DATE	FILE NAME
01-07-10	

DRAWN BY	SHEET
-	M-3.2

JOB NO. 05208.00

SCALE

Administration Building - Mechanical Roof Plan | Scale: 1/4"=1'-0" | 1

Notes